


NOTES:

1. CONCRETE SHALL BE 3000 P.S.I.
2. REINFORCING SHALL BE No. 4 BARS @ 12" E.W.
3. REINFORCING BARS SHALL BE DEFORMED AND TIED TOGETHER.
4. KEYING PIPES IS REQUIRED FOR ALL DIP INSTALLED @ 20% OR GREATER GRADE.
5. ANCHOR SPACING SHALL BE NOT OVER 36' FOR SLOPES FROM 20% TO 35%, NOT OVER 24' FOR OVER 35% TO 50%, AND NOT OVER 16' FOR SLOPES OVER 50%.
6. DUCTILE IRON PIPE MUST BE USED WHEN SLOPES ARE 18% OR GREATER

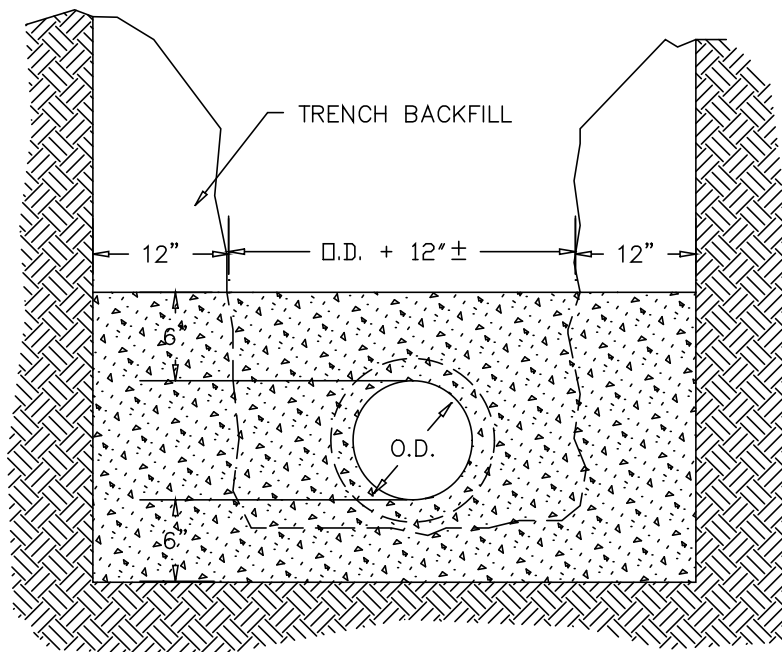

SECTION "A - A"

STANDARD DETAIL  
CITY OF CAYCE

KEYING PIPES ON SLOPES

APPROVED:

# CAYCE-10